LCSA
LOUDOUN COUNTY SANITATION AUTHORITY

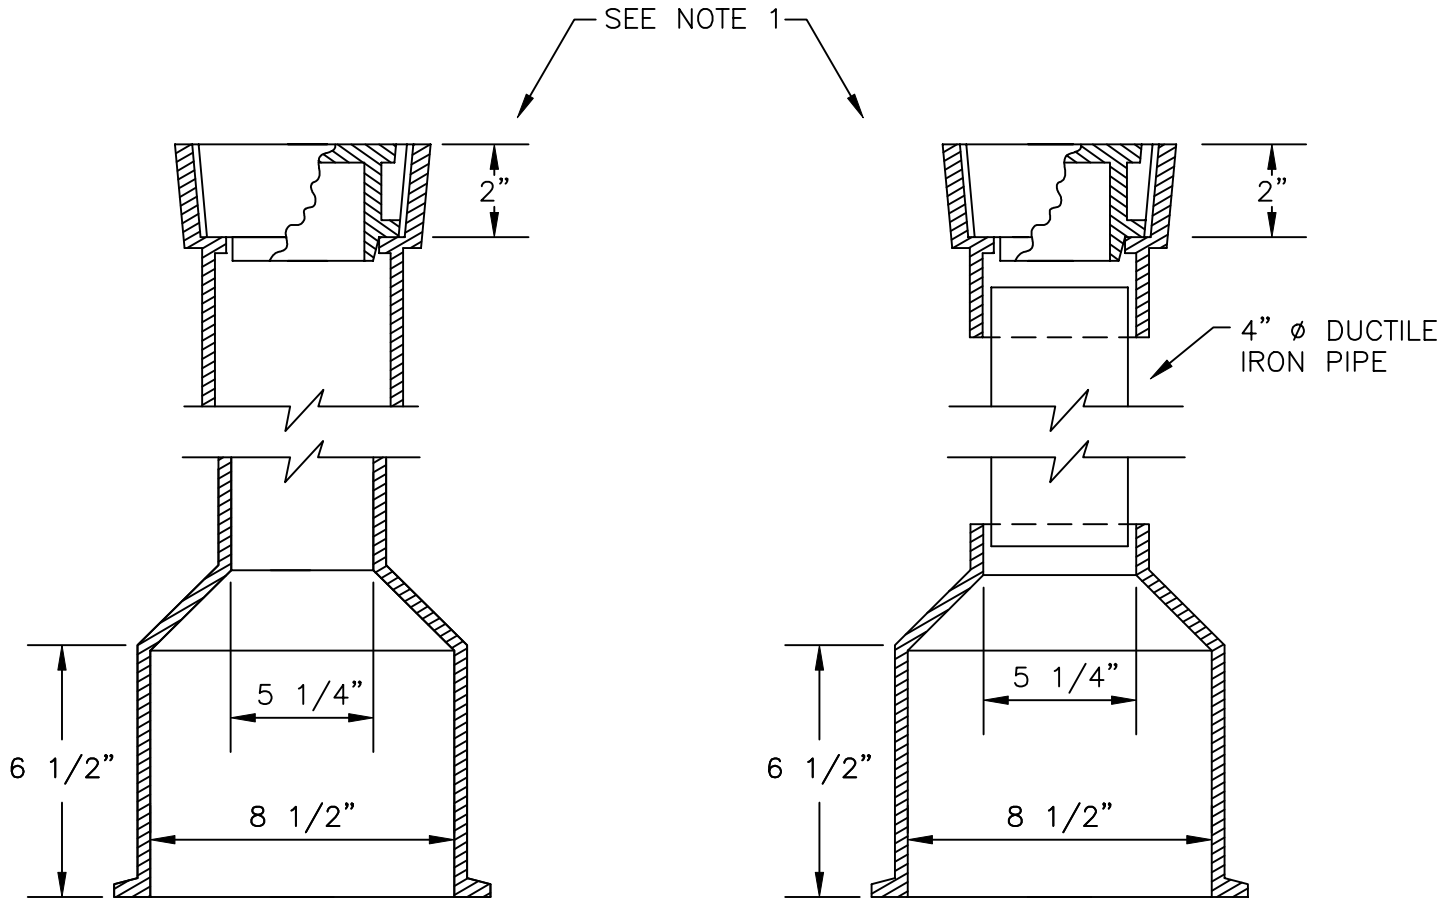

STANDARD DEPTHS

EXTENSION

NOTES:

1. EXTENTION BY 4" DUCTILE IRON PIPE TO BE USED WHERE SINGLE TOP AND BOTTOM DO NOT PROVIDE SUFFICIENT HEIGHT.
2. PROVIDE EXTENSION OF VALVE STEM WHERE OPERATING NUT WOULD BE MORE THAN 5 FEET BELOW GRADE.
3. VALVE BOXES OUTSIDE OF PAVEMENT REQUIRE 1'6"x1'6"x6" CONCRETE PAD.
4. REFER TO APPROVED PRODUCTS LIST FOR ADDITIONAL REQUIREMENTS.

06/02/02	VALVE BOXES	W21